

CCWD FIELD OPERATIONS

August 2023 Department Report

September 27th, 2023


West Point – HWY 26



SERVICE LINE REPAIR



SERVICE LINE REPAIR – WEST POINT WAREHOUSE

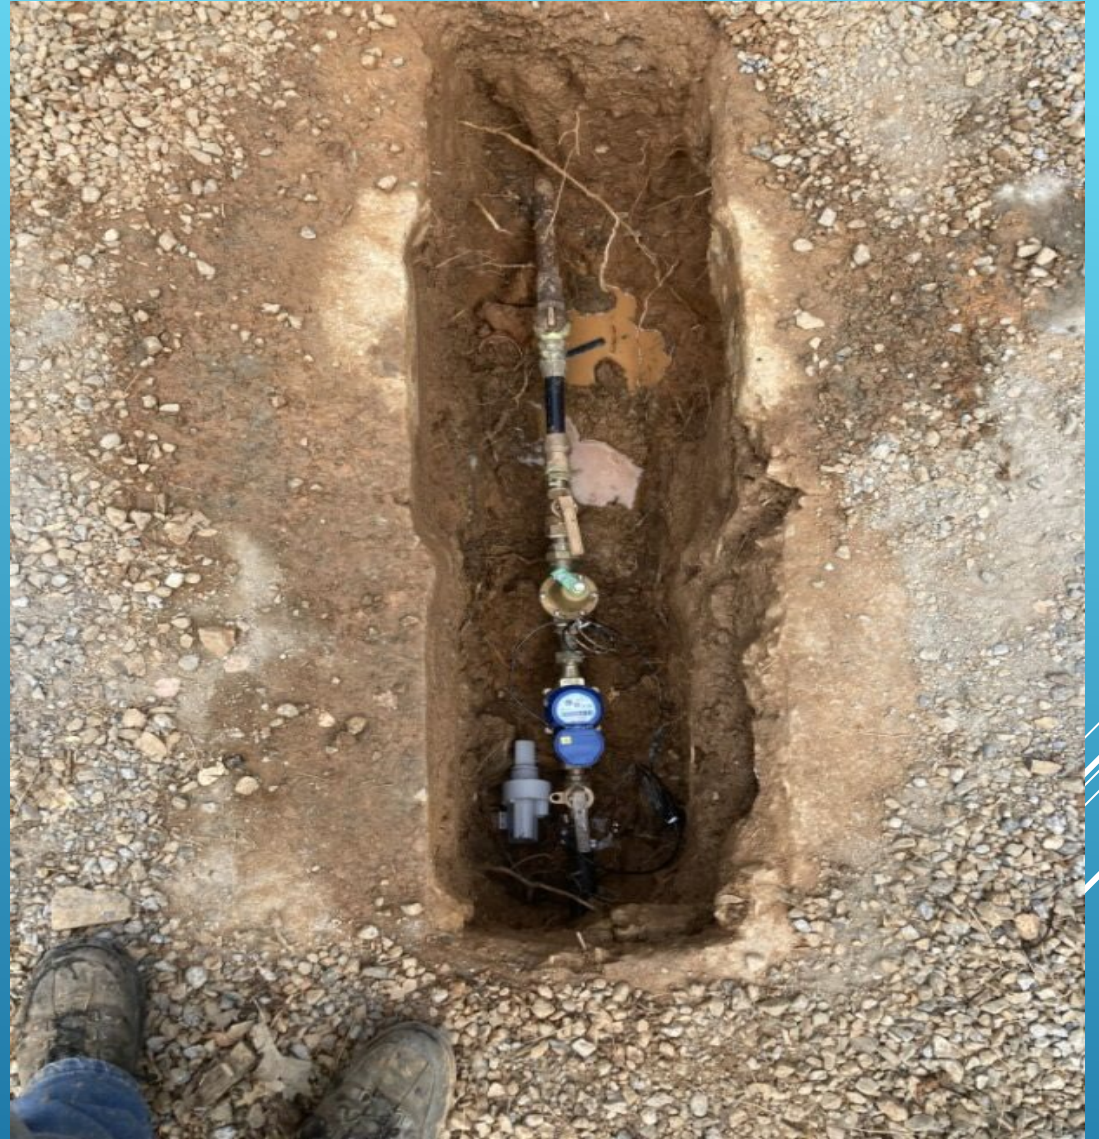

METER REPLACEMENT – BUMMERVILLE RD WEST POINT



LOCATING BURIED VALVES - WEST POINT



TREE LANE HYDRANT - WEST POINT



YARD CLEANUP – WEST POINT SHOP



HYDRANT REPLACEMENT – LAKEMONT – EBBETTS PASS



HYDRANT REPLACEMENT – LAKEMONT EBBETTS PASS



IMPROVING DRAINAGE FOR AN AUTOMATIC FLUSHER – BIG TREES VILLAGE - EP



REHABBING HYDRANT AND EXPOSED SERVICE – SHOSHONE – BIG TREES VILLAGE



POTHOLING TO UNDERSTAND ALIGNMENTS AND CORRECT MAPS - DORRINGTON



DRAINING PRV VAULTS – EBBETTS PASS



NEW HYDRANT INSTALLS – EBBETTS PASS



TAMARACK DRIVE LINE REPLACEMENT EBBETTS PASS



EXPOSING AND RESETTING VALVE LIDS – EBBETTS PASS



NIGHTTIME SERVICE LINE REPLACEMENT – COPPER COVE DRIVE



NIGHTTIME SERVICE LINE REPLACEMENT – COPPER COVE DRIVE



NIGHTTIME SERVICE LINE REPLACEMENT – COPPER COVE DRIVE



NIGHTTIME SERVICE LINE REPLACEMENT – COPPER COVE DRIVE



EMERGENCY SEWER LINE REPAIR – COPPER COVE



EMERGENCY SEWER LINE REPAIR – COPPER COVE




EMERGENCY SEWER LINE REPAIR – COPPER COVE





EMERGENCY SEWER LINE REPAIR – COPPER COVE




EMERGENCY TRANSDUCER REPLACEMENT – A TANK – VALLEY SPRINGS

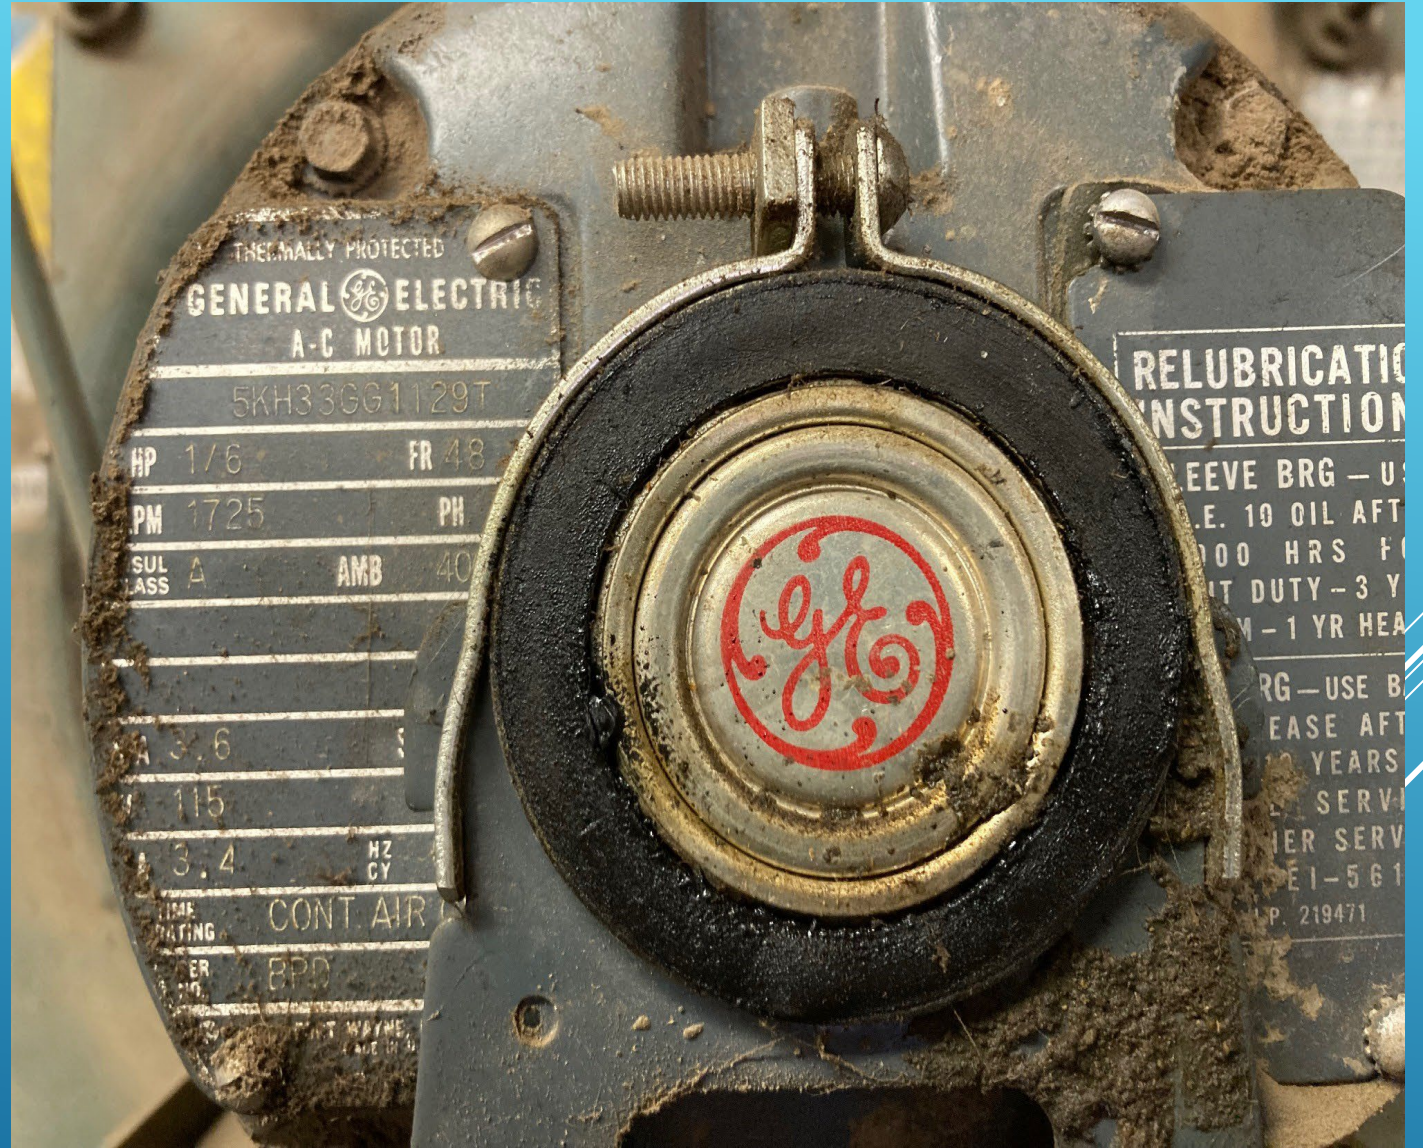

REPLACED EXHAUST FAN – DORRINGTON PUMP STATION – EBBETTS PASS

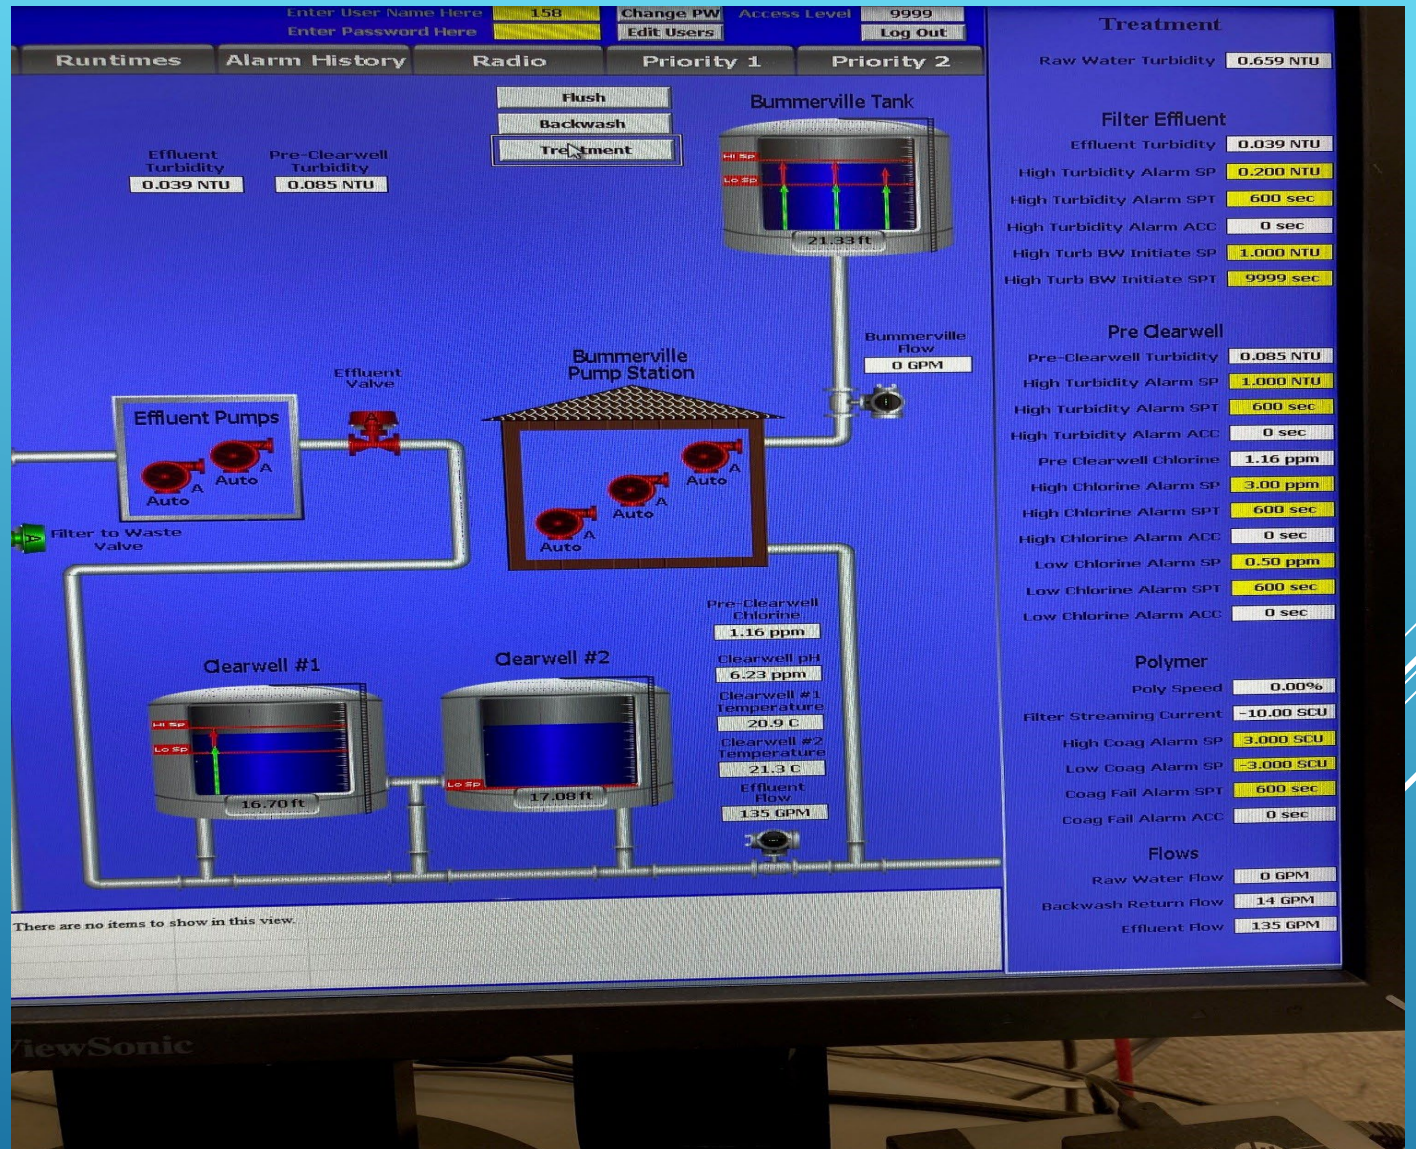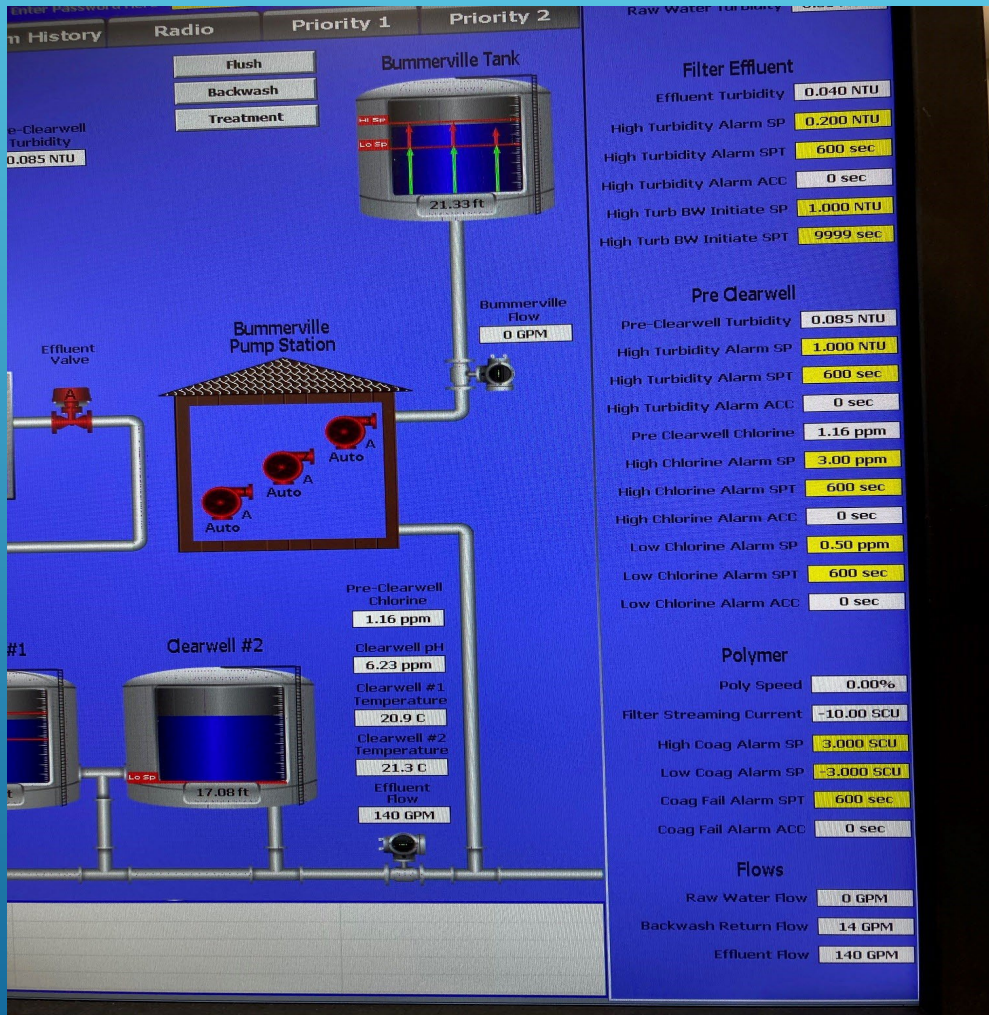

LOADED AND TESTED NEW SCADA SYSTEM - WEST POINT WTP

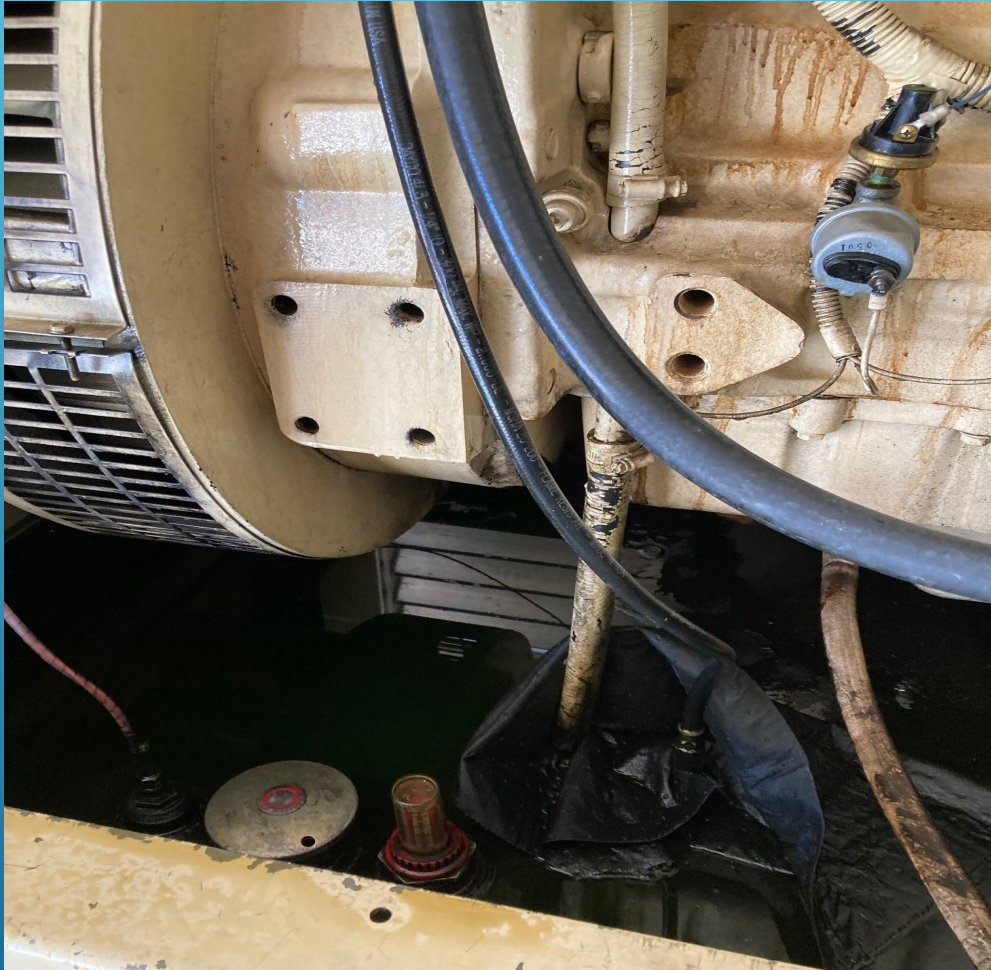

TROUBLESHOT AND REPAIRED HUCKLEBERRY LIFT STATION STANDBY GENERATOR – VALLEY SPRINGS

THANK YOU - QUESTIONS

- ▶ Replacement of Failed I/O base for the PLC at the Jenny Lind WTP – re-established filter backwash function and communication with the backwash basins

